
Technical liquid`s Tank TT -130 (S 1:50)

1–1

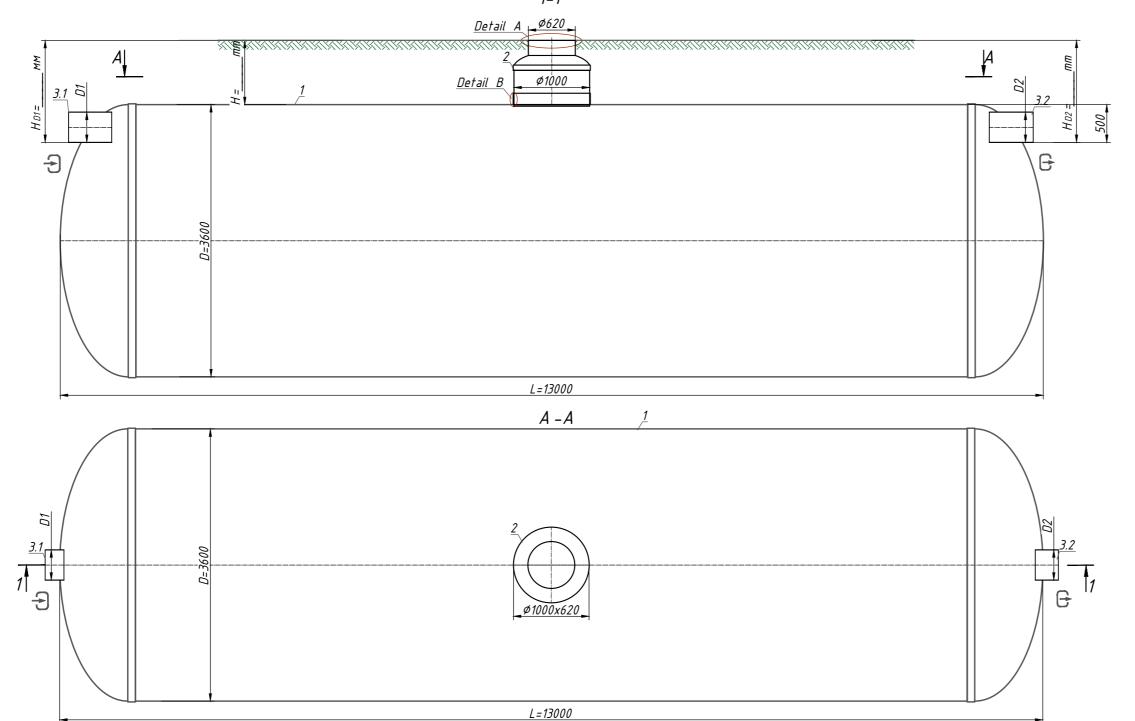

Noto

*H-depth of the inlet connection, mm (in standard equipment H up to 2000 mm). H take a multiple of 50mm.

When filling the manhole A.1-the overal height of the product is less than 200mm; A.2-the total height of the product is bigger than 100mm.


- **The product is shipped according to Standard Equipment(Tabl.1), unless otherwise specified in the Additional (Tabl.2). The full configuration of the product is agreed with the manager.
- ***The manufacturer has the right to make constructive and pattern changes that do not worsen the characteristics of the product as a whole

Permissible deviation during production of products is 1–3%.

Additional Information::

A -Manhole dezign*

B -Fixing the manhole with the tank***

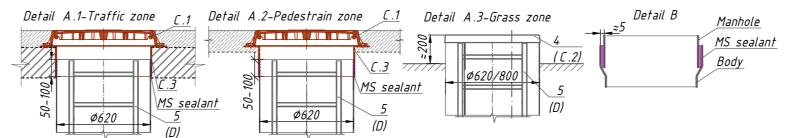

	Specification of materials a	pecification of materials and equipment. Standard equipment ** (Tabl.1)										
Pos.	Identification	Name	Q-ty	Mass pc. kg	Note							
1	Vodaland	Technical liquid`s Tank Vodaland TankTechnical-130,volume 130m³, horizontal, fiberglass, D=3600 mm L=13000 mm	1		compl.							
2		Inspection manhole Ø1000x620	1		compl.							
3.1,3.2	D1-Inlet pipe D2-Outlet pipe	Pipe PVC SN4 Ø 400	2		compl.							

**The product is shipped according to Standard Equipment(Tabl.1), unless otherwise specified in the Additional (Tabl.2)

	Additi	ional equipment (Tabl.2)									
Pos.	Identification	Identification Name									
A , B		D1-Inlet pipe/D2-Outlet pipe:	Ð	G							
	Pipework connection: D1, D2:	Socket end									
		Smooth end									
		An.:									
	Diameter D pipes D1,D2:	Ø90									
		Ø160									
		An.:									
C		<u>Manhole design</u> (se									
	C.1 Cover:	Garden plastic									
		Load class A15									
		Load class C250									
		Load class D400									
	C.2	Fiberglass coverØ620									
	C.3 Fiberglass adaptor plate	Ø620, h=200mm									
		None									
		An.:									
D	D.Universal ladder	Aluminum									
		s/s									
Ε	E.Fastening	Belt fastening									
F	F.Ventilation	Vent.pipe PVC SN4 Ø110 with fungus									
		An.:									
G	G.Additional equipment										

Rev.	Q-ty	Sh.	№doc.	Sign.	Date											
REV.	u-ry	311.	N-UUL.	Sigii.	Daie											
												Stage	.	Sheet	5	Sheets
						Techn	nical liqui	d`s Tan	k TT-	130			V	ODA	1	٨N
											- 1					

Format A3