



Technical liquid's Tank TT-140 (S 1:50)

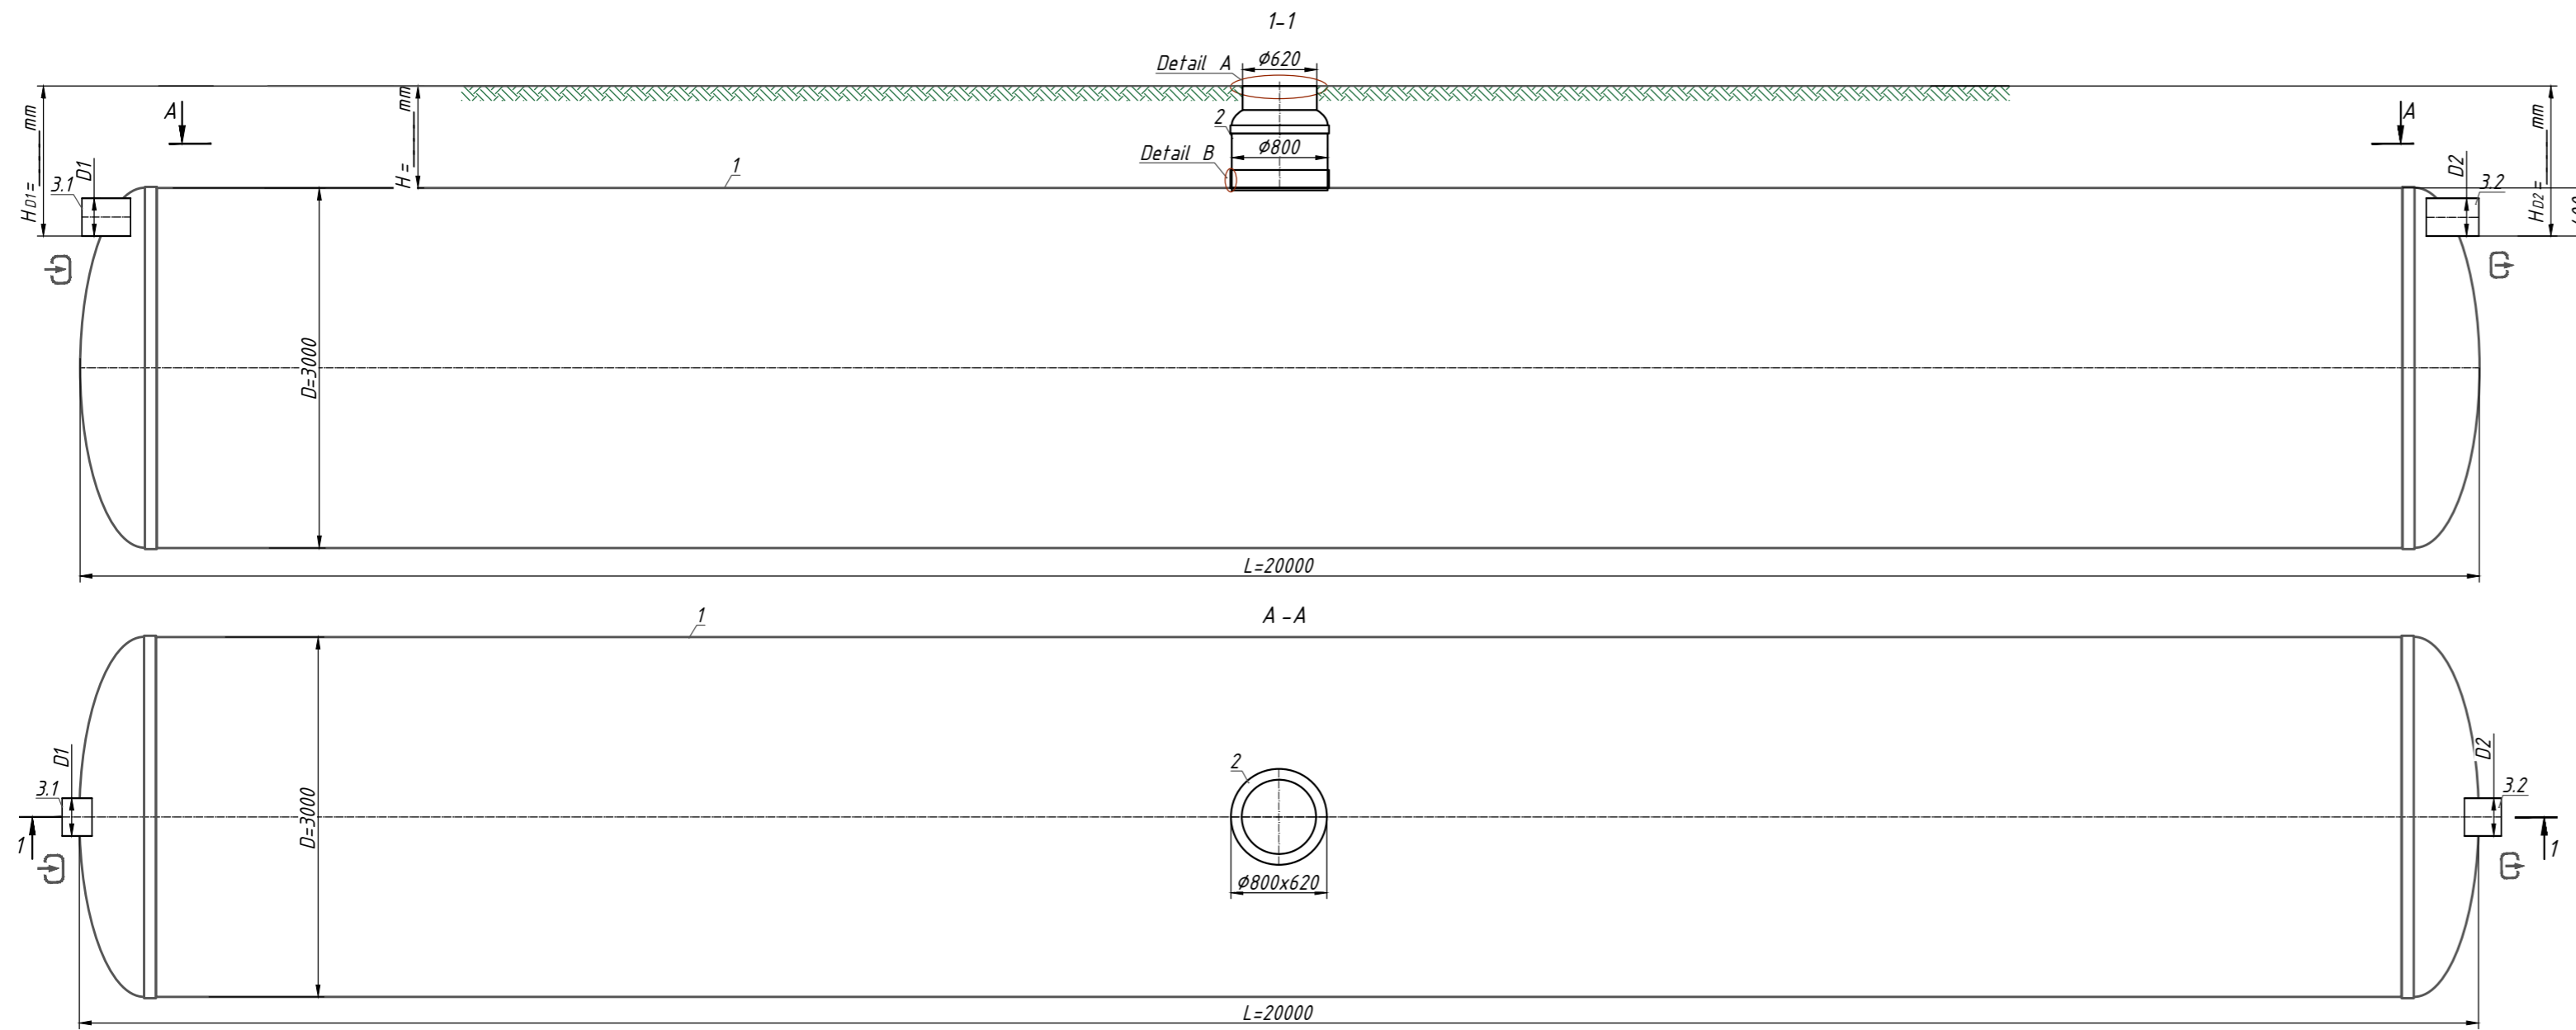

Note:
 *H-depth of the inlet connection, mm (in standard equipment H up to 2000 mm). H take a multiple of 50mm.
 When filling the manhole A.1-the overall height of the product is less than 200mm; A.2-the total height of the product is bigger than 100mm.
 **The product is shipped according to Standard Equipment(Tabl.1), unless otherwise specified in the Additional (Tabl.2). The full configuration of the product is agreed with the manager.
 ***The manufacturer has the right to make constructive and pattern changes that do not worsen the characteristics of the product as a whole
 Permissible deviation during production of products is 1-3%.

Additional Information: _____

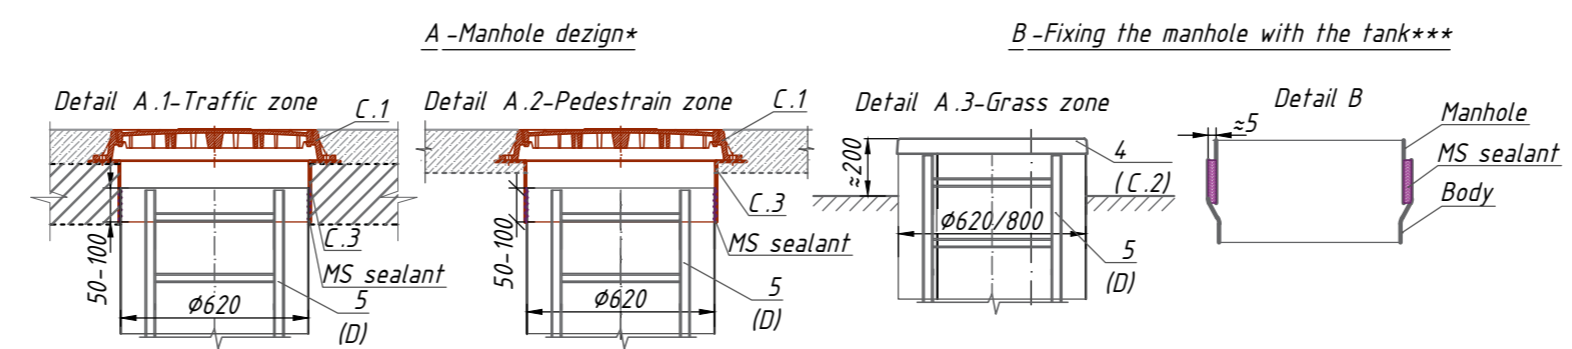

Specification of materials and equipment. Standard equipment ** (Tabl.1)

Pos.	Identification	Name	Q-ty	Mass pc. kg	Note
1	Vodaland	Technical liquid's Tank Vodaland Tank Technical-140, volume 140m ³ , horizontal, fiberglass, D=3000 mm L=20000 mm	1		compl.
2		Inspection manhole Ø800x620	1		compl.
3.1,3.2	D1-Inlet pipe D2-Outlet pipe	Pipe PVC SN4 Ø 315	2		compl.

**The product is shipped according to Standard Equipment(Tabl.1), unless otherwise specified in the Additional (Tabl.2)

Additional equipment (Tabl.2)

Pos.	Identification	Name			Note
A, B	D1-Inlet pipe/D2-Outlet pipe:		☐	☐	
	Pipework connection: D1, D2:	Socket end	☐	☐	
		Smooth end	☐	☐	
		An.:	☐	☐	
	Diameter D pipes D1,D2:	Ø90	☐	☐	
		Ø160	☐	☐	
An.:		☐	☐		
C	Manhole design (see A.1, A.2)				
	C.1 Cover:	Garden plastic	☐		
		Load class A15	☐		
		Load class C250	☐		
		Load class D400	☐		
	C.2 Fiberglass cover Ø620	☐			
		C.3 Fiberglass adaptor plate	☐		
Ø620, h=200mm		☐			
	None	☐			
	An.:	☐			
D	D.Universal ladder	Aluminum	☐		
		s/s	☐		
E	E.Fastening	Belt fastening	☐		
F	F.Ventilation	Vent.pipe PVC SN4 Ø110 with fungus	☐		
G	G.Additional equipment	An.:	☐		

Rev.	Q-ty	Sh.	Nºdoc.	Sign.	Date	Stage	Sheet	Sheets

Technical liquid's Tank TT-140