



Technical liquid's Tank TT-45 (S 1:30)

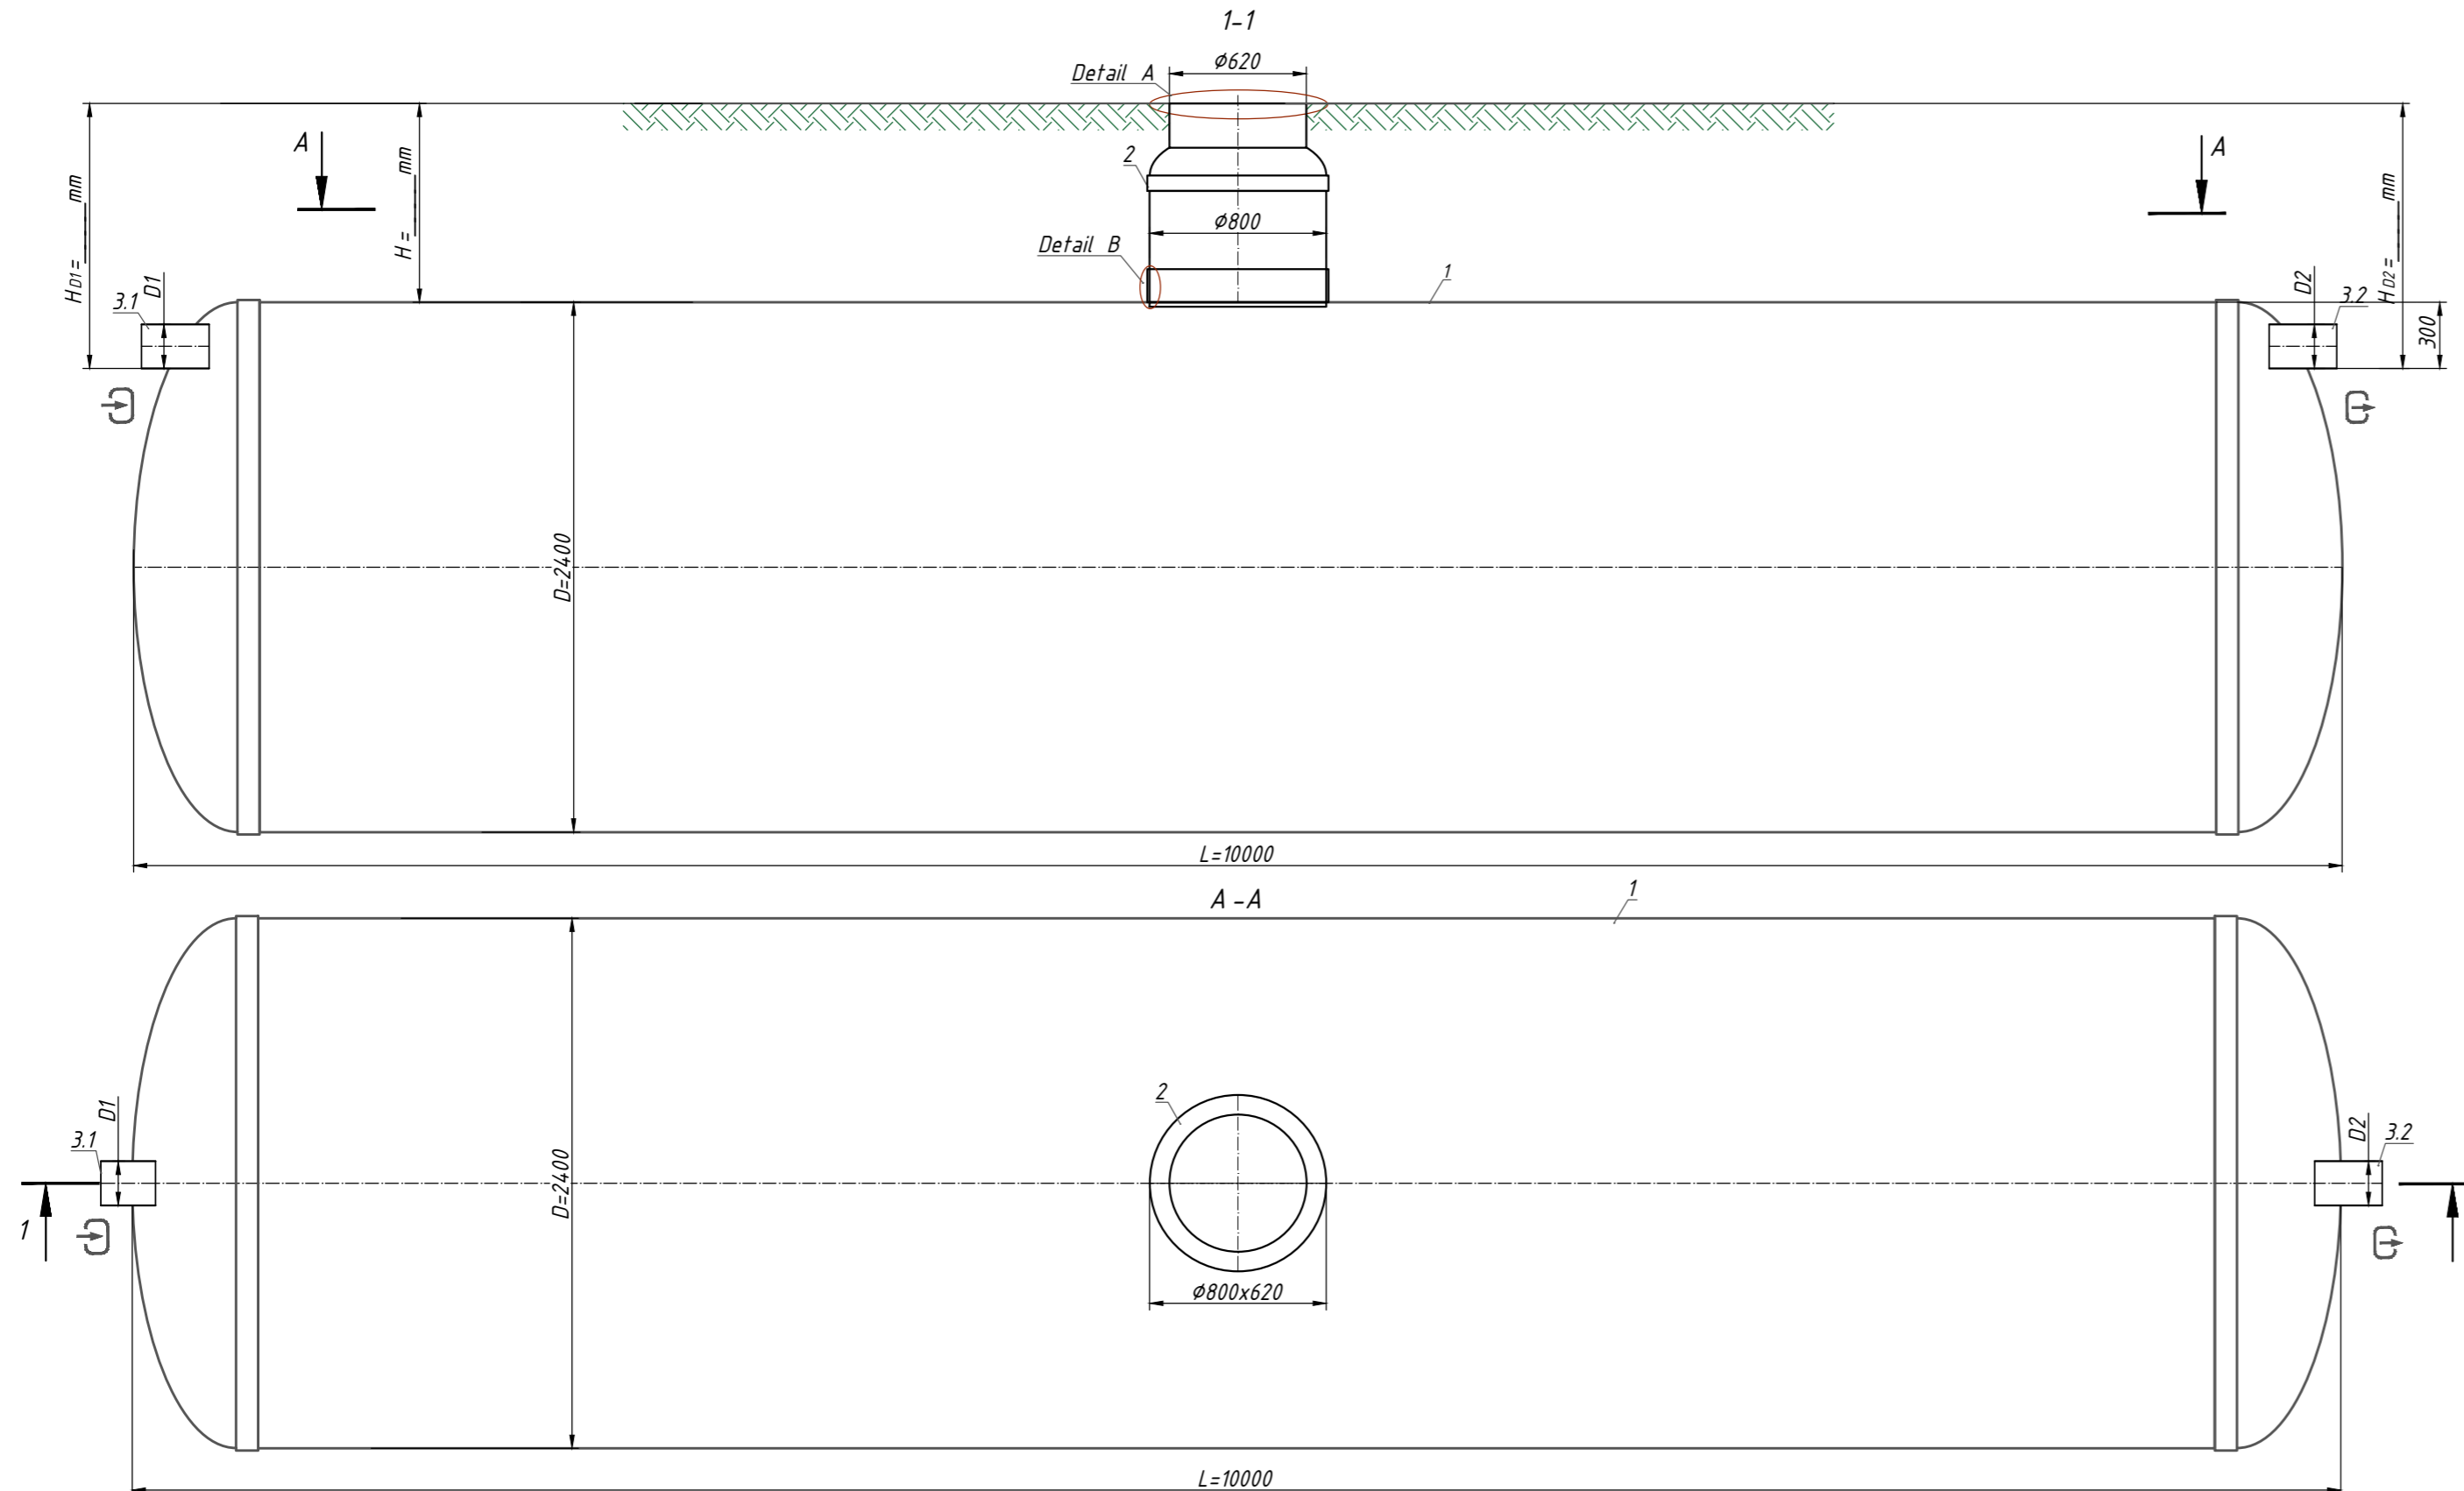

Note:  
 \*H-depth of the inlet connection, mm (in standard equipment H up to 2000 mm). H take a multiple of 50mm.  
 When filling the manhole A.1-the overal height of the product is less than 200mm; A.2-the total height of the product is bigger than 100mm.  
 \*\*The product is shipped according to Standard Equipment(Tabl.1), unless otherwise specified in the Additional (Tabl.2). The full configuration of the product is agreed with the manager.  
 \*\*\*The manufacturer has the right to make constructive and pattern changes that do not worsen the characteristics of the product as a whole  
 Permissible deviation during production of products is 1-3%.

Additional Information: \_\_\_\_\_

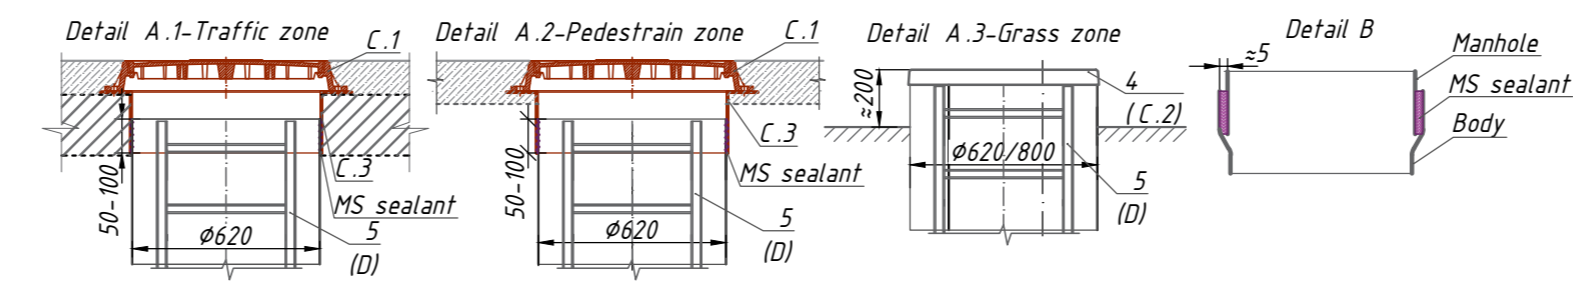

Specification of materials and equipment. Standard equipment \*\* (Tabl.1)

Pos.	Identification	Name	Q-ty	Mass pc. kg	Note
1	Vodaland	Technical liquid's Tank Vodaland Tank Technical-45, volume 45m <sup>3</sup> , horizontal, fiberglass, D=2400 mm L=10000 mm	1		compl.
2		Inspection manhole 800x620	1		compl.
3.1,3.2	D1-Inlet pipe D2-Outlet pipe	Pipe PVC SN4 200	2		compl.

\*\*The product is shipped according to Standard Equipment(Tabl.1), unless otherwise specified in the Additional (Tabl.2)

Additional equipment (Tabl.2)

Pos.	Identification	Name			Note	
A, B	D1-Inlet pipe/D2-Outlet pipe:		☐	☐		
		Pipework connection: D1, D2:	Socket end	☐	☐	
		Smooth end	☐	☐		
	Diameter D pipes D1,D2:	An.:	☐	☐		
		☉90	☐	☐		
		☉160	☐	☐		
C	C.1 Cover: C.2 C.3 Fiberglass adaptor plate	Manhole design (see A.1, A.2)				
		Garden plastic	☐			
		Load class A15	☐			
		Load class C250	☐			
		Load class D400	☐			
		Fiberglass cover 620	☐			
		620, h=200mm	☐			
None	☐					
An.:	☐					
D	D.Universal ladder	Aluminum	☐			
		s/s	☐			
E	E.Fastening	Belt fastening	☐			
F	F.Ventilation	Vent.pipe PVC SN4 110 with fungus	☐			
G	G.Additional equipment	An.:	☐			

Rev.	Q-ty	Sh.	Nºdoc.	Sign.	Date	Stage	Sheet	Sheets